


NOTES:

1. MATERIALS, METHODS OF INSTALLATION, CURING, TESTING, SHALL CONFORM TO "STATE OF CT DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FORM 814A, OR 815 @ 1995 OR CURRENT SPECIFICATION FOR SUCH WORK.
2. ANY WALKING SURFACE SHALL BE LIGHTLY BROOMED PERPENDICULAR TO THE TRAVEL WAY.
3. WIRE MESH SHALL BE PLACED 2" BELOW THE SIDEWALK SURFACE. MATERIAL SHALL BE 6"x6" NO. 10 GAGE AND IN ACCORDANCE WITH ASTM 185 ( AASHTO M55 ),AS SHOWN ON THE PLANS OR AS DIRECTED. WIRE MESH TO BE USED IN ALL COMMERCIAL SIDEWALK APPLICATIONS. MESH MAY BE OMITTED ONLY WITH THE SPECIFIC AUTHORIZATION OF THE CITY ENGINEER ON A CASE-BY-CASE BASIS, OR IN A BID SPECIFICATION.


**CITY OF NEW HAVEN  
DEPARTMENT OF ENGINEERING**

RICHARD H. MILLER, P.E., L.S. 9886  
CITY ENGINEER

DRIVE: K:\ENGINEER\DWG  
FILE: CITYSTD\DETAILS\2009 DETAILS  
DATE: DEC. 1, 2009  
DRAWING NO.: **STD-NH-04A**

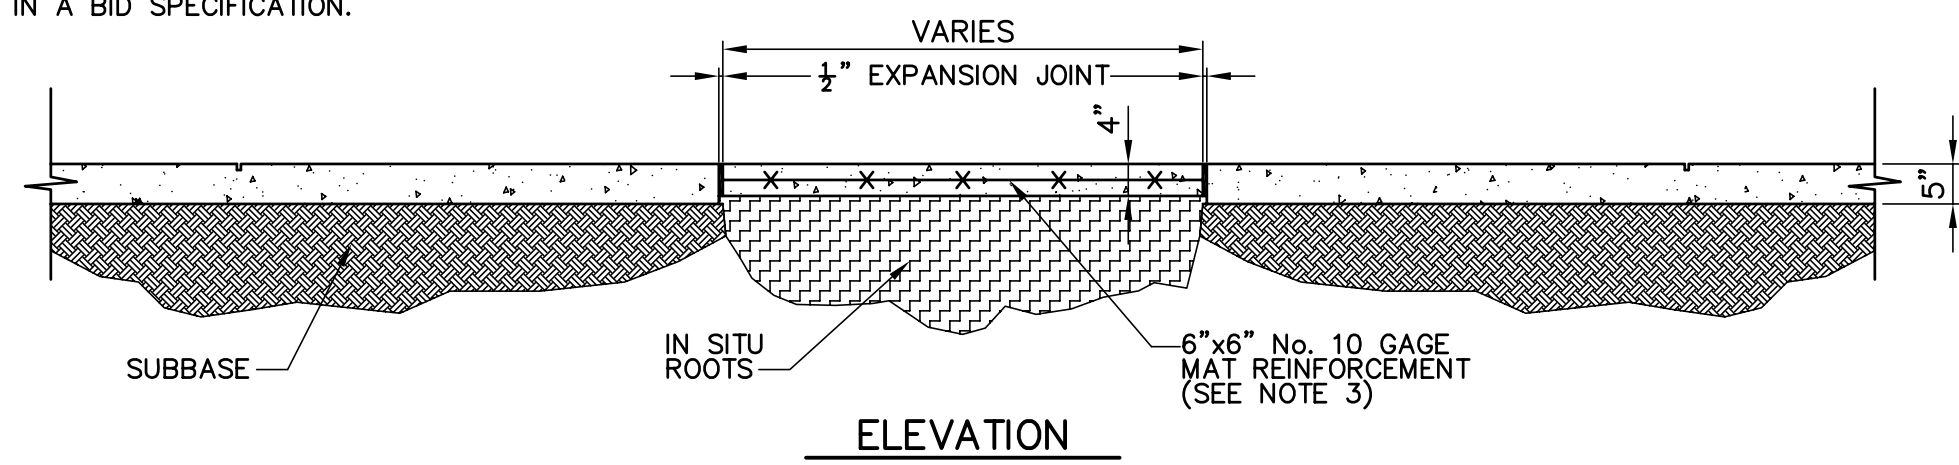

**ELEVATION**

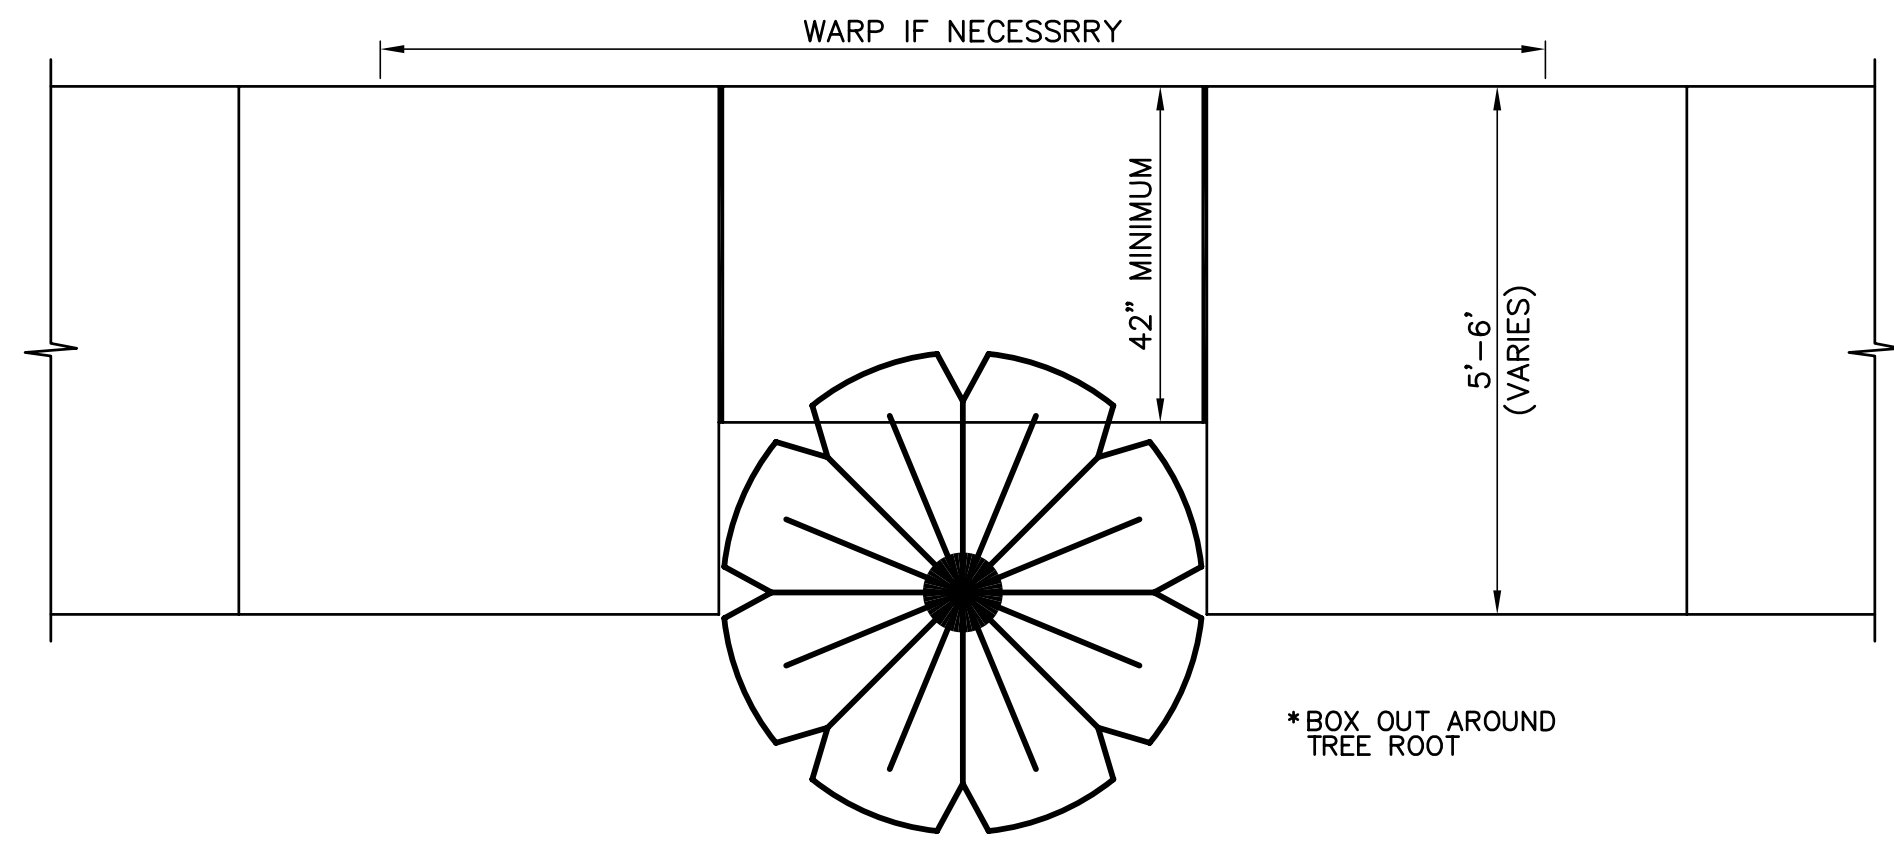

**PLAN**

**SIDEWALKS AT EXPANDED TREE LOCATIONS**

SCALE 1/2"=1'-0"